



PLAN

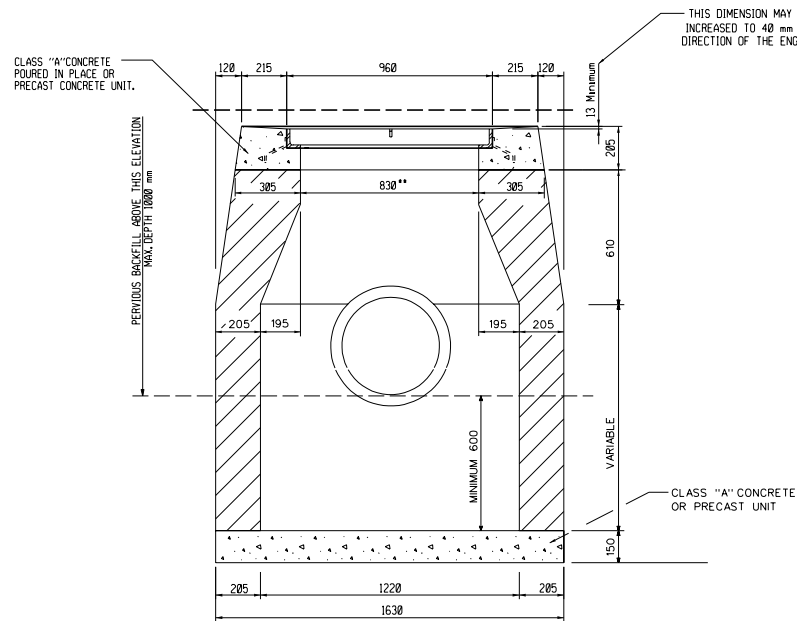

SECTION A-A

TYPE "C-L" CATCH BASIN

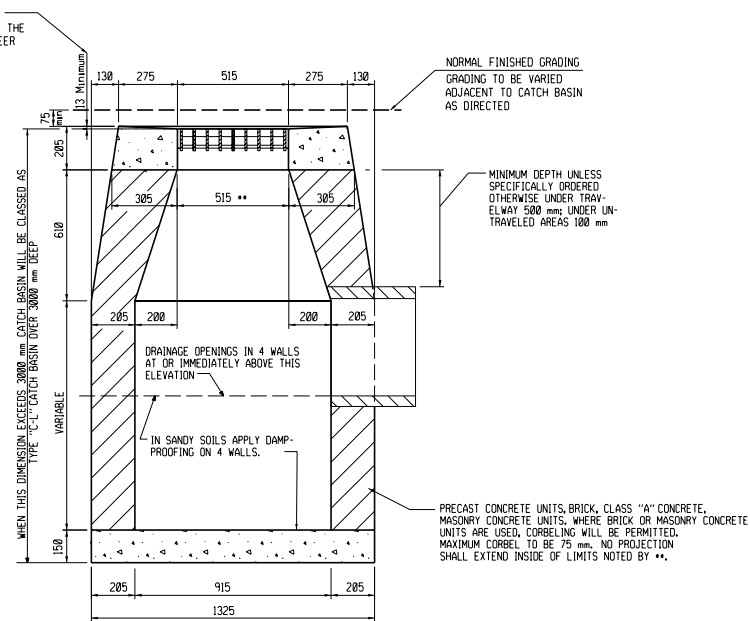

SECTION B-B

- PRECAST CONCRETE UNIT NOTES:
1. PRECAST CONCRETE UNITS MAY BE USED IN PLACE OF MASONRY UNITS WITH THE FOLLOWING CONDITIONS:
 - a) WALL THICKNESS SHALL BE AT LEAST 205 mm.
 - b) FOR WALL THICKNESS LESS THAN 205 mm, REINFORCEMENT AND KEYWAYS WILL BE NECESSARY. FOR DETAILS SEE STANDARD SHEET NO. M507-H.
 - c) ANY JOINTS SHALL BE HORIZONTAL AND SHALL BE MORTARED.
 - d) THE DIMENSIONS MAY BE VARIED PROVIDED THAT THE INSIDE DIMENSIONS OF THE UNITS ARE GREATER THAN THE MINIMUM INSIDE DIMENSIONS SHOWN.

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS (mm) EXCEPT AS NOTED.
2. FOR DETAILS OF FRAME AND GRATE, SEE STANDARD SHEET M507-K.
3. WALLS OF ALL CATCH BASINS OVER 3 m DEEP TO BE INCREASED TO 305 mm INSIDE DIMENSIONS TO REMAIN THE SAME.